



RADON INSPECTION REPORT

Document Generated

12/04/2021

Document Number

RP22110280034_02Dec21_1157

Test Performed For

Sample Person

Device S/N

RP22110280034

Measurement Date

12/02/2021 - 12/04/2021


Inspection Duration

48 hour (Data No: 48)

Measurement Location

Sample Drive

Reidsville , North Carolina 27320

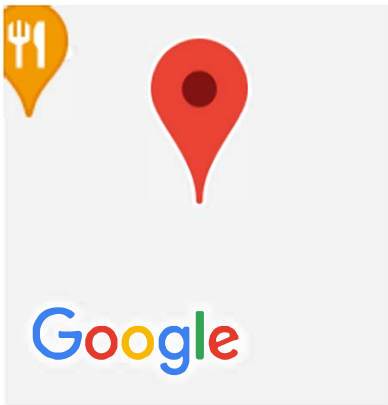

Inspector

HomeTek Inspection Services Young

Inspector Phone

336-989-8185

Inspector Address

806 Green Valley Road STE 200
Greensboro, North Carolina 27408

Test Started
12/02/2021 11:57

Test Ended
12/04/2021 11:57

Inspection Duration
48 hours

Calibrated
10/28/2021

Wait Time
0 hour

Radon Concentration max
3.7

Radon Concentration min
1.0

Overall Avg
2.2

EPA Protocol Avg
2.3

NOTE: The calculated EPA average excludes the first 4 hrs measures to follow EPA protocol.

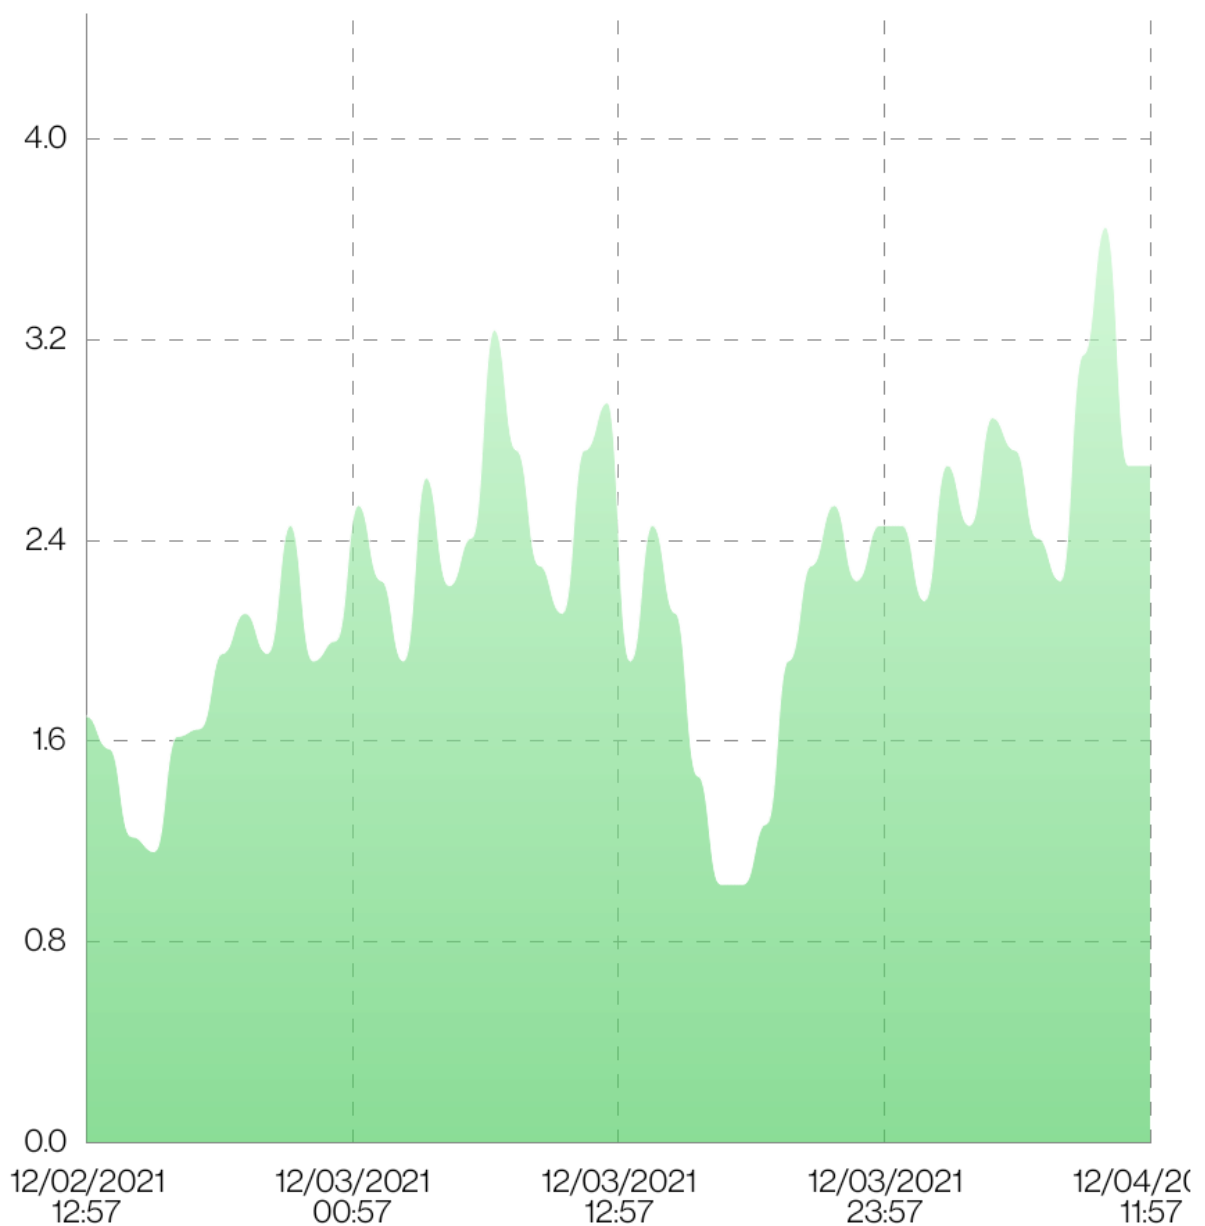


Table of Hourly Radon Measurements

Radon Concentration Average: 2.2 pCi/ℓ

Timestamp	Radon Value	Temp(F)	RH(%)	Timestamp	Radon Value	Temp(F)	RH(%)
12/02/21 12:57	1.7	71	52	12/03/21 12:57	1.9	65	52
12/02/21 01:57	1.6	69	51	12/03/21 01:57	2.5	65	51
12/02/21 02:57	1.2	68	51	12/03/21 02:57	2.1	66	51
12/02/21 03:57	1.2	68	51	12/03/21 03:57	1.5	66	51
12/02/21 04:57	1.6	67	51	12/03/21 04:57	1.0	66	51
12/02/21 05:57	1.6	67	52	12/03/21 05:57	1.0	66	52
12/02/21 06:57	1.9	66	52	12/03/21 06:57	1.3	65	52
12/02/21 07:57	2.1	66	52	12/03/21 07:57	1.9	65	53
12/02/21 08:57	1.9	65	52	12/03/21 08:57	2.3	64	54
12/02/21 09:57	2.5	65	52	12/03/21 09:57	2.5	64	54
12/02/21 10:57	1.9	65	52	12/03/21 10:57	2.2	64	54
12/02/21 11:57	2.0	64	53	12/03/21 11:57	2.5	64	54
12/03/21 12:57	2.5	64	53	12/04/21 12:57	2.5	64	55
12/03/21 01:57	2.2	64	53	12/04/21 01:57	2.2	63	55
12/03/21 02:57	1.9	64	53	12/04/21 02:57	2.7	63	55
12/03/21 03:57	2.6	63	53	12/04/21 03:57	2.5	62	56
12/03/21 04:57	2.2	63	54	12/04/21 04:57	2.9	62	56
12/03/21 05:57	2.4	63	55	12/04/21 05:57	2.8	62	56
12/03/21 06:57	3.2	62	55	12/04/21 06:57	2.4	63	56
12/03/21 07:57	2.8	62	55	12/04/21 07:57	2.2	62	56
12/03/21 08:57	2.3	62	55	12/04/21 08:57	3.1	62	55
12/03/21 09:57	2.1	62	55	12/04/21 09:57	3.6	62	56
12/03/21 10:57	2.8	63	54	12/04/21 10:57	2.7	62	55
12/03/21 11:57	2.9	64	52	12/04/21 11:57	2.7	64	54

* Temperature and humidity can vary depending on environmental conditions.